


MORTARLESS BRICK PAVER


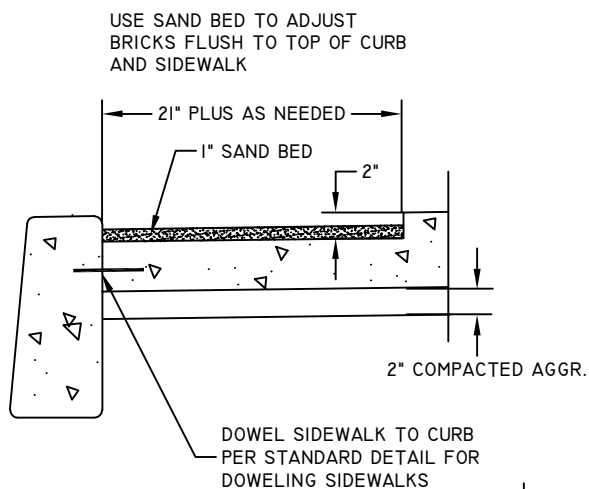


5 FOOT SECTION
AT TREE WELL ONLY

6 ROWS OF
BRICKS

5' X 5'
TREE WELL

DEEP
TOOL
JOINT
1/4 OF
THICKNESS
OF
CONCRETE

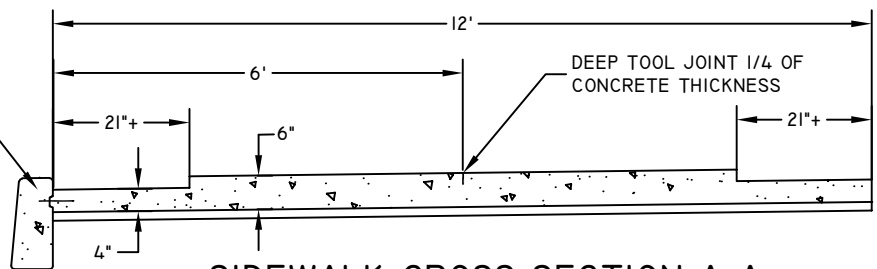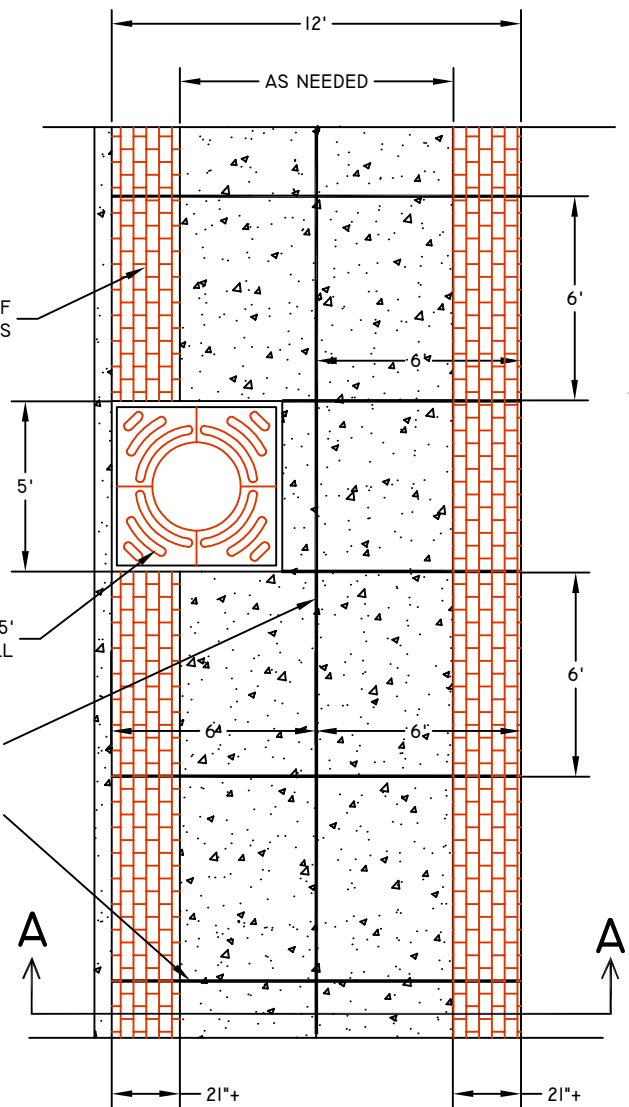

SIDEWALK CROSS SECTION A-A

NOTES:

1. CONCRETE TO REACH STRENGTH OF 3000 P.S.I. IN 28 DAYS 2" TO 4" SLUMP.
2. EXPANSION JOINTS TO BE PLACED AT SIDES OF DRIVEWAY APPROACHES, UTILITY VAULTS & AT SPACING NOT TO EXCEED 90' OR AS DIRECTED BY THE ENGINEER.
3. FOR SIDEWALKS ADJACENT TO THE CURB & POURED AT THE SAME TIME AS THE CURB . THE JOINT BETWEEN THEM SHALL BE A TROWELED JOINT WITH A MIN. 1/2" RADIUS.
4. DRAIN BLOCKOUTS IN CURBS SHALL BE EXTENDED TO BACK OF SIDEWALK WITH 3" DIA. SCH. 40 ABS OR PVC PIPE AT 2% SLOPE, CONTRACTION JOINT TO BE PLACED OVER PIPE.